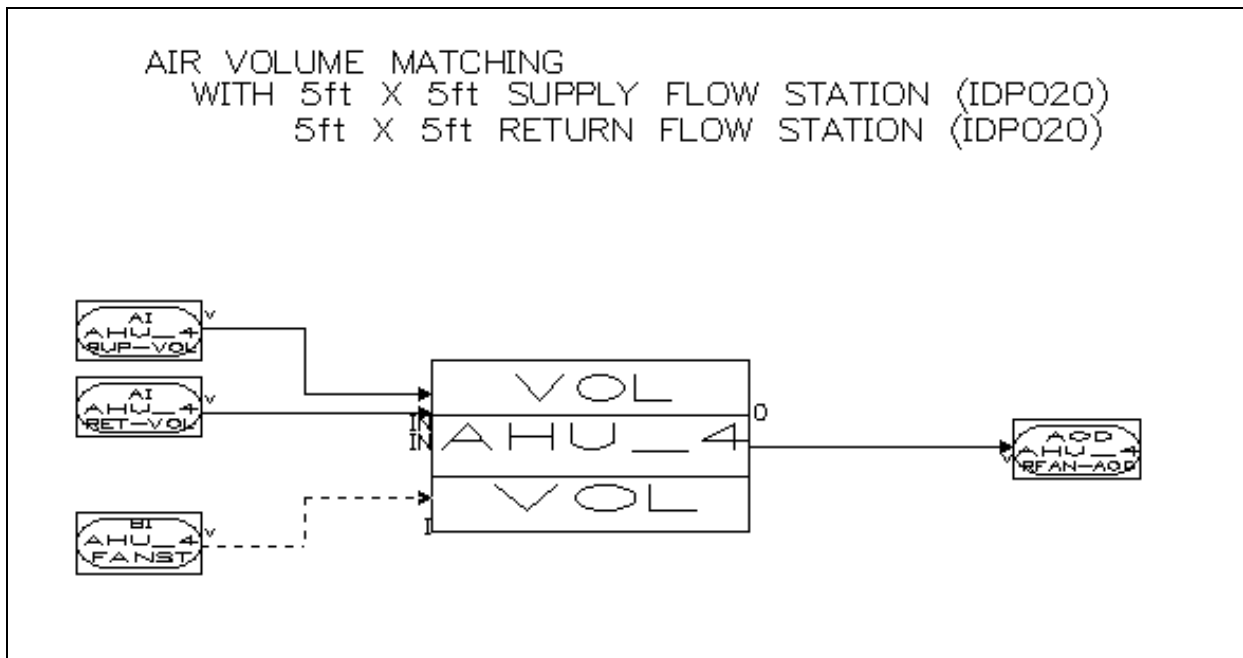


AHU4 Examples File



**Figure 1: Air Volume Matching with 5 ft x 5 ft Supply Flow Station (IDP020)
 5 ft x 5 ft Return Flow Station (IDP020)**

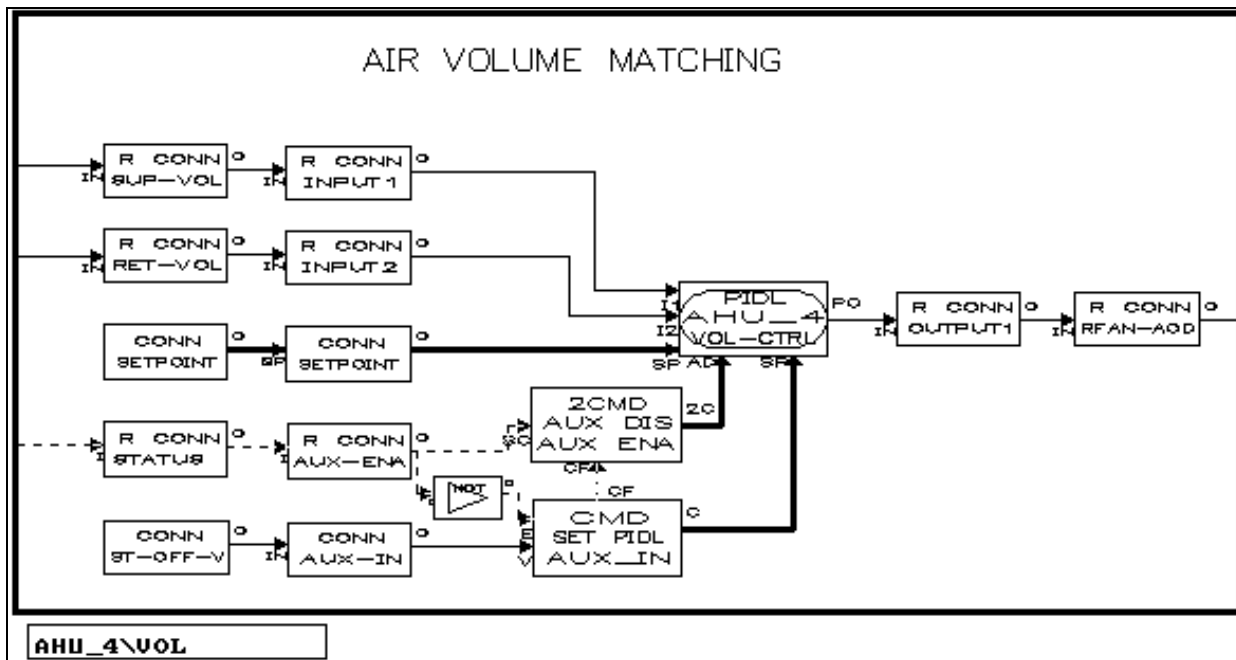


Figure 2: VOL—Air Volume Matching

JOHNSON
CONTROLS

Controls Group
507 E. Michigan Street
P.O. Box 423
Milwaukee, WI 53201

FAN 636
Metasys Network Technical Manual
Revision Date 0590
Printed in U.S.A.